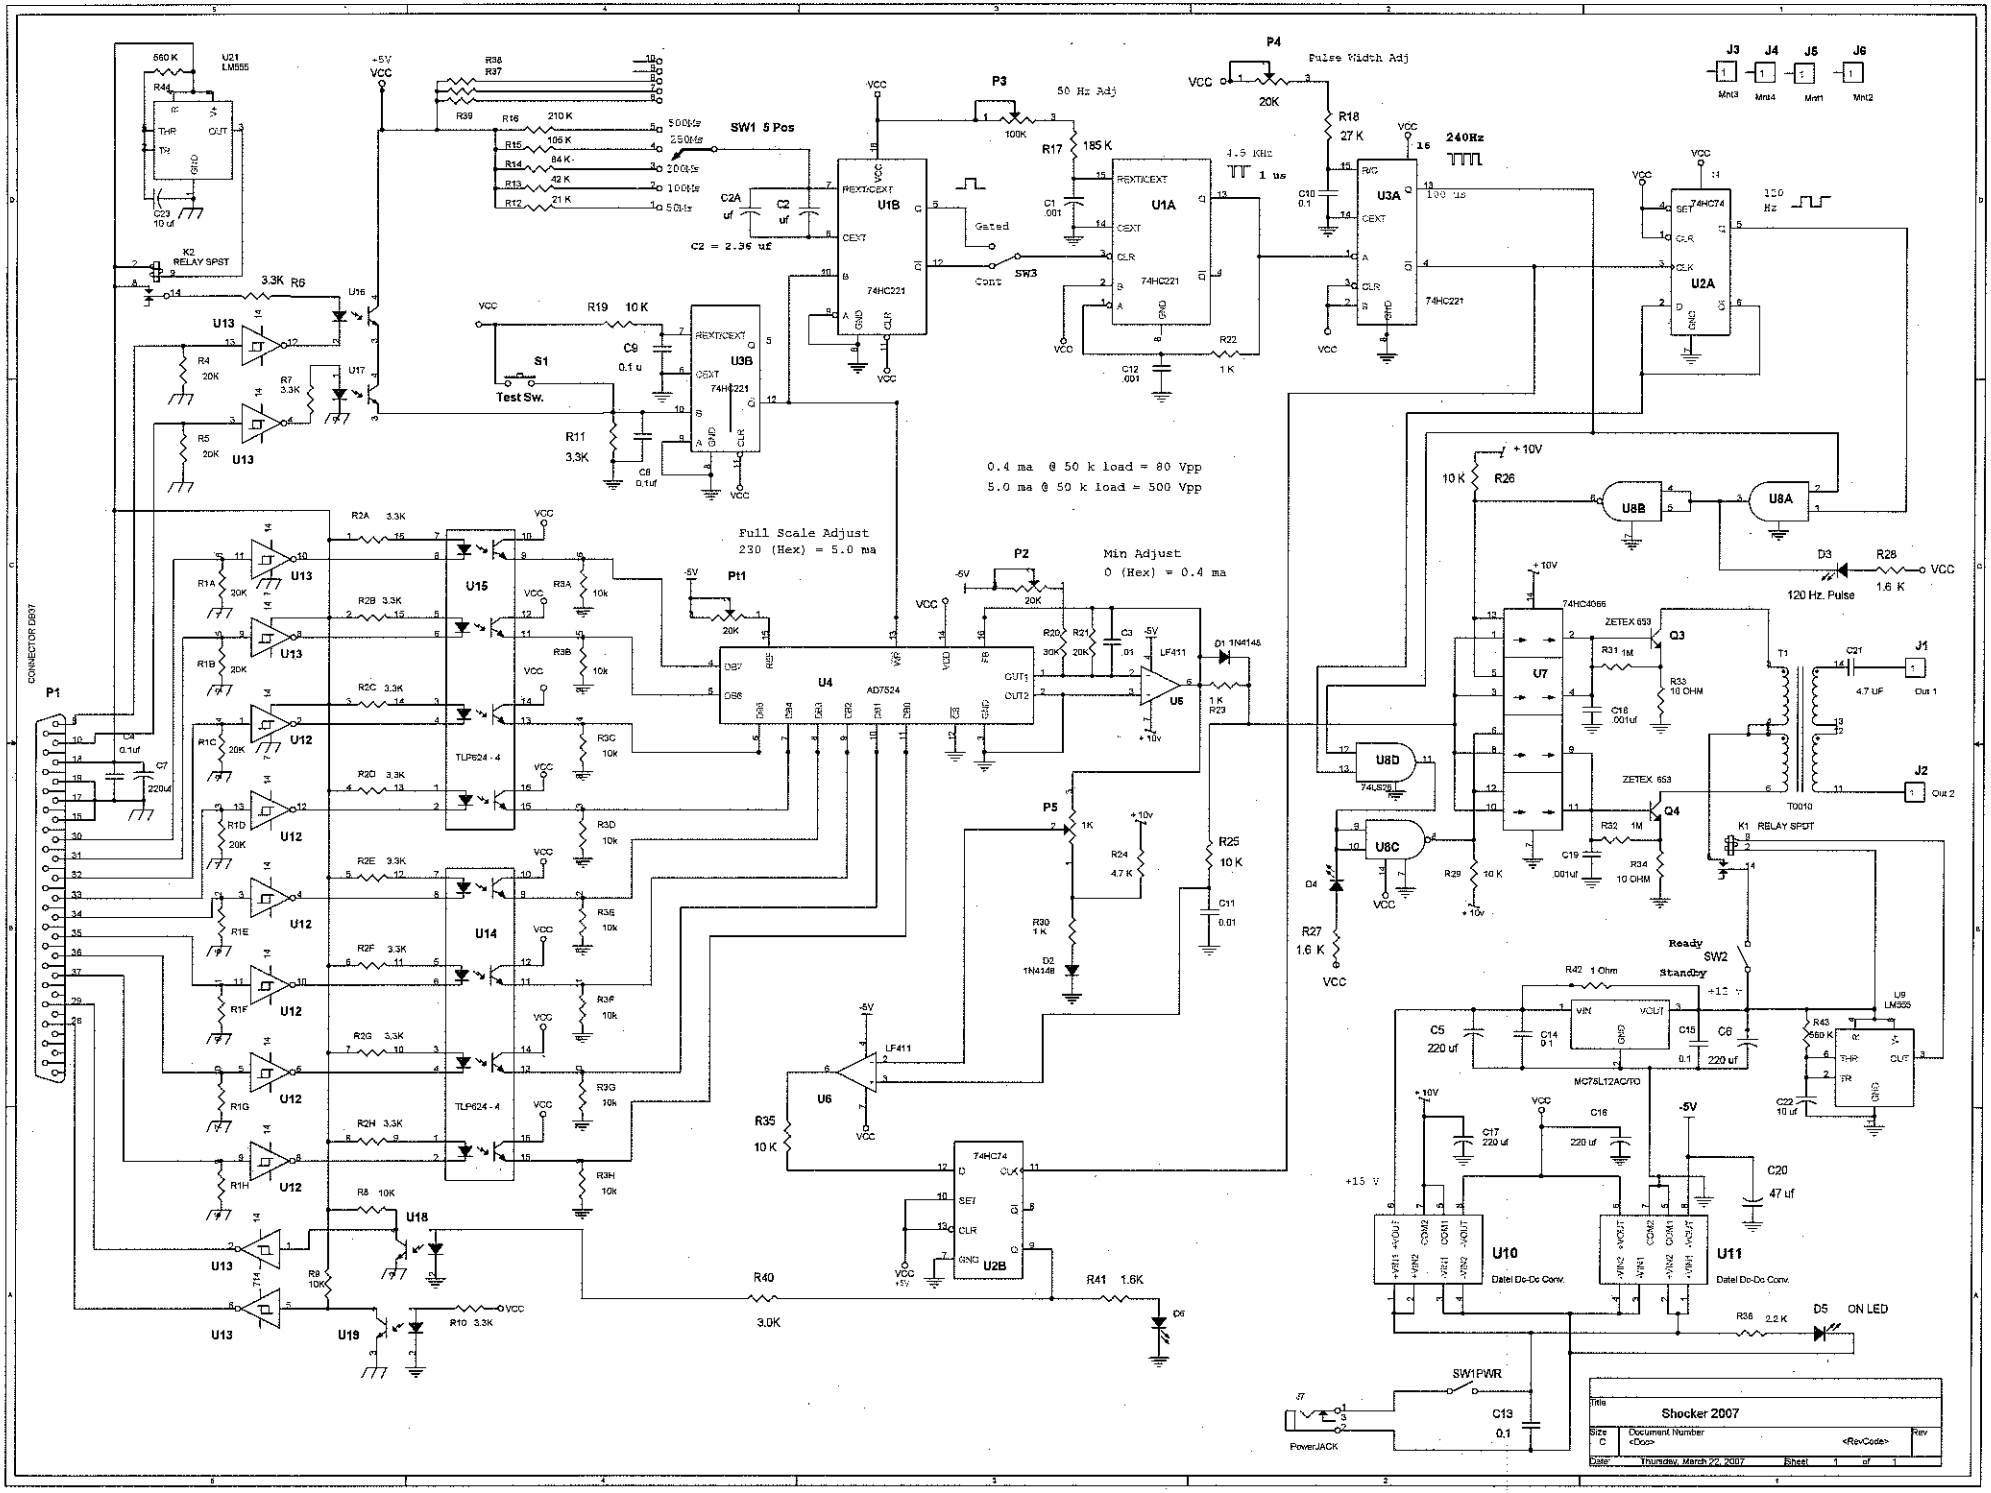
Shocker 2007
Pulse Width Adj
50 Hz Adj
SW1 5 Pos
Test Sw.
Gated
Cont
SW3
RELAY SPST
Full Scale Adjust
230 (Hex) = 5.0 ma
Min Adjust
0 (Hex) = 0.4 ma
0.4 ma @ 50 k load = 80 Vpp
5.0 ma @ 50 k load = 500 Vpp
120 Hz. Pulse
240Hz
4.5 KHz
1 us
100 us
Ready
Standby
SW2
SW1PWR
PowerJACK
ON LED
CONNECTOR DB37
AD7524
74HC221
74HC74
74HC4066
TLP624-4
LF411
MC75L12ACP
Datel Dc-Dc Conv.
ZETEX 653
T0010
Thursday, March 22, 2007